

# Investigation of supercooled water droplet sticking efficiency during power transmission line icing using digital holography

Pu Zhang, Dengxin Hua, Jiang Cheng, Jingjing Liu, Xiang Xu, Yitong Miao, Jun Wang\*  
Xi'an University of Technology, Xi'an, China

5 Correspondence to: Jun Wang (wangjun790102@xaut.edu.cn)


**Abstract.** Transmission line icing severely threatens the safety of the power grid. Accurate prediction of the sticking efficiency (the proportion of supercooled droplets that remain on the conductor after impact, excluding bouncing and splashing) is critical for preventing and mitigating icing disasters. Traditional prediction models for sticking efficiency typically exhibit significant errors under complex conditions (e.g., varying wind speeds and precipitation intensities), thereby limiting their practical applications. To overcome this limitation, a two-stage coupled model based on coaxial digital holography was proposed. In this mode, the diameters, velocities, and collision angles of supercooled droplets were accurately measured and incorporated into a two-stage framework that couples droplet impact dynamics with thermodynamic processes to calculate sticking efficiency. For the laboratory and field-validation cases examined in this study, the prediction errors of the proposed model remained below 3.5% under various conditions, representing a significant improvement over traditional models and underscoring its enormous potential in engineering applications.

15 **Keywords:** transmission line icing; sticking efficiency; digital holography; two-stage coupled model

[1]: Addresses Reviewer #2 Specific Comment 1 and Reviewer #1 Minor Comment 4: changed 'multi-stage' to 'two-stage coupled model' and clarified that the <3.5% value is an absolute relative error relative to the laboratory/field reference sticking efficiencies, not a universal guarantee.

[2]: Reviewer #2 Specific Comment 1: Terminology was standardized from "multi-stage" to "two-stage coupled model" in the keywords and corresponding manuscript locations.

Graphical abstract

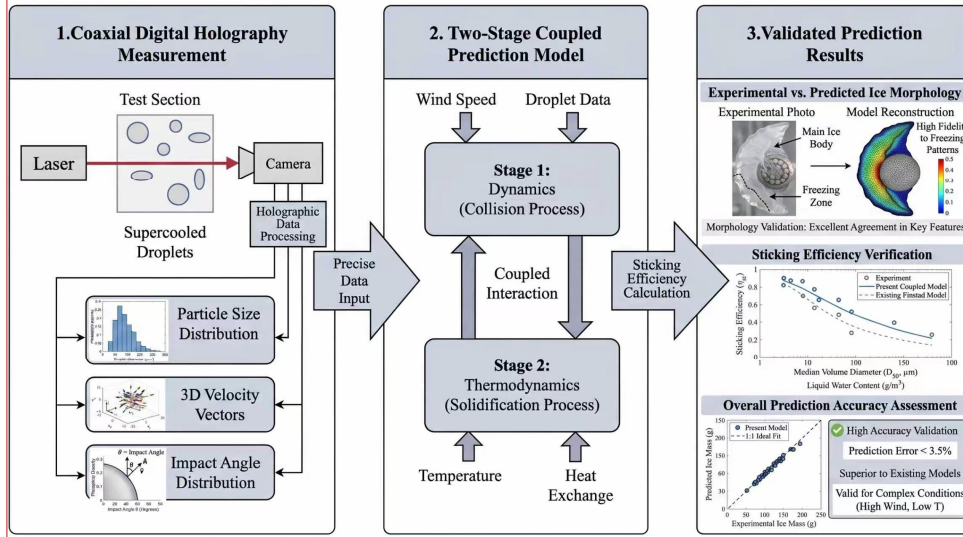

[3]: Addresses Reviewer #2 Specific Comments 2-3: graphical abstract revised to remove unclear icon-like elements/arrows and to better reflect the experimental sticking-efficiency trends.

20 **1 Introduction**

Accidents (such as tower collapses, wire breakages, and flashover trips) caused by transmission line icing seriously threaten the safety of power grids. Therefore, accurately predicting transmission line icing conditions is crucial for preventing and mitigating ice-related disasters (Wang et al., 2024). Among various prediction methods, physical icing models are considered the most precise paradigm for predicting transmission line icing, and the accurate calculation of their relevant parameters has long been a focus of researchers (Hou et al., 2024). In physical icing models, the ice accretion rate on transmission lines is typically determined by the collision efficiency, sticking efficiency, and freezing efficiency of supercooled raindrops. **In the present study, sticking efficiency is defined as the fraction of incident supercooled droplets that remain adhered to the conductor surface after impact, excluding losses caused by rebound, splashing, and aerodynamic stripping.** Among these, sticking efficiency has long been regarded as a challenging and overlooked aspect of research. In recent years, although some progress has been made in calculating sticking efficiency through numerical simulations and artificial intelligence applications, there are still significant deficiencies in experimental observations and theoretical modeling of the sticking efficiency mechanism. Makkonen and Stallabrass (2019) have utilized high-speed photography to observe droplet impact dynamics, which improves the accuracy of

[4]: Addresses Reviewer #2 Major Comment 4; Reviewer #1 Minor Comments 2-4; and Reviewer #1 Technical Corrections 1-2: defines sticking efficiency, distinguishes it from collection efficiency, softens the literature-based error statement, clarifies the cited limitation of previous work, and checks citation consistency.

droplet velocity measurements but fails to accurately determine the collision angle of droplets impacting the transmission line surface. Jiang et al. have employed Laser diffraction-based characterization to measure the particle size distribution of raindrops in freezing rain; however, it's unable to measure the three-dimensional (3D) motion vector of single droplets (Jiang et al., 2021). Kringlebotn Nygaard et al. have modified the Makkonen model for wet snow accretion by introducing an adhesion parameterization scheme based on liquid water content, but it still could not describe the complex impact process of supercooled water droplets (Kringlebotn Nygaard et al., 2013). Liu et al. have introduced physics-informed neural networks (PINNs) to solve the icing flow field. Although the accuracy is high within the interpolation range, the model's extrapolation ability under high turbulence conditions is poor due to the lack of physical constraints for extreme splashing scenarios (Liu et al., 2024). Snaiki et al. have developed a neural network based on meta-heuristic optimization, which improves data fitting but relies on macroscopic observational data from meteorological stations and lacks an explanation of the micro-physical mechanisms of icing (Jamali et al., 2024). The computational fluid dynamics-discrete element method (CFD-DEM) coupled model established by Gao et al. considers the two-way coupling of micron-sized droplets and conductor vibration but neglects the shear effect of oblique droplet impact (Gao et al., 2024). In summary, current research on the sticking efficiency of transmission line icing faces problems of missing measurements for wind speed, temperature, particle size, and collision angle, failing to comprehensively account for the combined effects of dynamic and thermodynamic factors during the icing process. Limited by these issues, existing icing collection rate models often exhibit errors exceeding 30% under complex operating conditions, making it difficult to meet the needs of practical prediction.

Digital holography technology records and reconstructs the interference patterns of light waves, and when combined with image processing technology, it can acquire information about particle number, size, shape, and spatial distribution (Gao, 2024; Javidi et al., 2021; Khodadad, 2024). In the present context, this means that the reconstruction does not rely on an a priori assumption of spherical particles and can therefore be applied to droplets or fragments with non-spherical or dynamically evolving shapes. With the rapid development of computers and high-resolution CCD or CMOS sensors, it has been widely used in fields such as medical imaging (Huang and Cao, 2024; Mihaylova, 2024), holographic projection (Blinder et al., 2022), cloud microphysics (Chambers et al., 2024; Fuchs et al., 2025), non-destructive testing (Osten and Pedrini, 2022), and particle field measurement (Kumar and Hong, 2025; Yang et al., 2024). Building on this, this study employs a coaxial digital holographic 3D measurement system to achieve synchronous and precise measurement of the particle size distribution, spatial motion trajectory, and collision angle of supercooled raindrops. Based on these measurements, this study develops a two-stage coupled model for icing sticking efficiency that integrates the dynamic collision process with thermodynamic solidification. The proposed model overcomes the limitations of traditional isolated models, which are typically applicable only to specific scenarios. For the validation cases considered in this study, the prediction error of sticking efficiency is reduced to below 3.5% relative to the corresponding laboratory or field reference values, providing technical support for early warning and protection against transmission line icing.

[5]: Addresses Reviewer #1 Minor Comment 3 and Reviewer #2 Major Comment 4: clarifies what was meant by digital holography not being limited by particle shape and improves the Introduction's logical flow.

## 2 Theoretical background

Transmission line icing is fundamentally a dynamic process, in which supercooled raindrops collide with the conductor, then adhere, and finally freeze and accumulate. The outcome of a supercooled droplet's impact is jointly determined by both the dynamic attachment process and the thermal freezing process (Fu et al., 2006).

70 The dynamic attachment of a supercooled droplet to the conductor depends on the competition between inertia and surface tension (Zhang et al., 2020). When a droplet strikes the conductor at a given speed, inertia drives it to diffuse along the surface of the conductor into a thin film, while the surface tension of the droplet resists diffusion and tends to pull the droplet back into a spherical shape. The relative strength of these two effects can be characterized by the dimensionless Weber number ( $We$ ), defined as the ratio of the droplet's kinetic energy upon impact to the surface tension's restorative energy. In other words, the Weber  
75 number represents the magnitude of inertial force relative to the capillary force. The Weber number can be expressed as:

$$We = \frac{\rho(v_d \sin \theta)^2 d}{\sigma}, \quad (1)$$

where  $\rho$  is the droplet density,  $v_d$  is the incoming velocity of the droplet,  $d$  is the droplet diameter,  $\theta$  is the angle between the droplet's velocity vector and the wire's surface normal, and  $\sigma$  is the surface tension. The Weber number quantifies the degree to which the droplet's kinetic energy drives diffusion deformation upon impact: when  $We > 1$ , inertia dominates and the  
80 droplet will completely diffuse and may even splash and break up; when  $We \leq 1$ , the surface tension prevails and the droplet tends to remain intact and adhere. Under the competition between inertia and capillarity, a critical Weber number  $We_c$  serves as the criterion for whether the droplet will adhere. If  $We < We_c$ , the droplet can fully adhere to the surface; If  $We > We_c$ , the droplet will fragment and splash, failing to adhere.

The core of the thermal freezing process lies in the heat transfer and equilibrium when a supercooled droplet undergoes liquid-solid phase change upon contacting the surface of the subfreezing conductor. Once a droplet attaches to a conductor surface below  
85  $0^\circ\text{C}$ , the supercooling  $\Delta T$  drives heat transfer from the droplet to the conductor at the solid-liquid interface, eliminating the latent heat released by the droplet during freezing. For a droplet to freeze completely, the rate of heat conduction must balance the rate of the latent heat release, so as to remove all the latent heat prior to droplet detaches. The different dimensions of the heat conduction rate and the total latent heat, make it hard to compare them directly. Therefore, the effective contact time  $t_c$  (the time  
90 the droplet remains attached to the conductor) and the minimum freezing time  $t_f$  (the minimum time required for the droplet to solidify) are introduced. The freezing time of a droplet is directly proportional to the square of its characteristic size and inversely proportional to its degree of supercooling. Accordingly, a dimensional analysis gives the approximate relation:

$$t_f \approx \frac{\rho L d^2}{k \Delta T}, \quad (2)$$

[6]: Addresses Reviewer #1 Technical Correction 5 and Reviewer #2 Specific Comments 4-5: standardizes  $v_d/v_n$  notation, retains parameter definitions.

where  $L$  is the latent heat of fusion of water per unit mass, and  $k$  is the thermal conductivity. Equation (2) indicates that the freezing time can be prolonged by larger droplets while shortened by a greater ambient supercooling. Therefore, the success criterion for the thermal phase lies in that the droplet must be completely frozen before separate, namely, the effective contact time of the droplet must be greater than or equal to its minimum freezing time.

In summary, only by precisely obtaining key physical parameters of the supercooled droplets - such as their size, impact velocity, and collision angle - can the sticking efficiency be calculated accurately. For this purpose, a coaxial digital holographic 3D measurement system is used to measure these parameters.

Coaxial digital holography offers a simple optical setup, high information density, and minimal dual image interference in the far field, enabling its extensive application in recording and reconstructing three dimensional dynamic fields (Chen et al., 2021; Liu et al., 2021; Zhou, 2024). When a planar laser wave illuminates the particle field, the light diffracted by a particle (object beam) will interfere with the undisturbed reference beam. The interference pattern is recorded as a digital hologram. Afterwards, using the Fresnel-Kirchhoff diffraction formula, the object wave can be numerically reconstructed. According to scalar diffraction theory, if the measurement volume contains  $n$  particles, the reconstructed wave field  $U_R(u, v)$  (Goodman, 1968; Gao et al., 2021) at the reconstruction plane coordinates  $(u, v)$  is given by the follows:

$$U_R(u, v) = \frac{1}{j\lambda} \iint_{\infty} R(x, y) I_H(x, y) \frac{\exp\left(jk\sqrt{(u-x)^2 + (v-y)^2 + z_r^2}\right)}{\sqrt{(u-x)^2 + (v-y)^2 + z_r^2}} dx dy, \quad (3)$$

where  $\lambda$  is the laser wavelength;  $R(x, y)$  is the reference wave;  $I_H(x, y)$  is the intensity of the interference fringes of the hologram;  $k$  is the wavenumber;  $x$  and  $y$  are the horizontal and vertical coordinates in the particle focal plane, respectively;  $u$  and  $v$  are the horizontal and vertical coordinates in the hologram reconstruction plane, respectively; and  $z_r = z_i (i = 1, 2, 3 \dots)$

are reconstruction distances. Equation (3) represents the reconstructed wave field generated by the superposition of the contributions from the  $n$  particles contained within the sampled measurement volume. A particle located at a reconstruction distance  $z_r$  will be focused on the reconstruction plane. By reconstructing the hologram at a series of different distances  $z_r$ , information about all particles within the sampled volume can be obtained. By applying an image fusion technique - specifically, a grayscale gradient variance method combined with a third-order Laplacian pyramid fusion algorithm - to the reconstructed digital images, the droplet particle sizes and three-dimensional positions can be measured with high accuracy. The application of a particle image recognition algorithm to the particles in the sampled volume yields the particle count.

By recording the time series of holograms through multiple exposures, the motion trajectories of the droplets can be obtained. In the reconstructed sequential particle images, each particle is tagged frame by frame and its 3D coordinates  $(x, y, z, t)$  are extracted. The displacement of a particle between two successive frames is:

[7]: Addresses Reviewer #1 Minor Comment 5 and Reviewer #2 Specific Comment 5: corrects latent heat to per unit mass.

[8]: Addresses Reviewer #1 Minor Comment 6 and Reviewer #1 Technical Correction 3: explains how the  $n$  particles enter Eq. (3).

$$\Delta s = \sqrt{(x_i - x_{i+1})^2 \Delta x^2 + (y_i - y_{i+1})^2 \Delta y^2 + (z_i - z_{i+1})^2 \Delta z^2}, \quad (4)$$

from which the instantaneous droplet impact velocity can be determined using particle tracking velocimetry as:

$$v = \frac{\Delta s}{\Delta t}, \quad (5)$$

where  $\Delta t$  is the exposure time interval between adjacent frames. Using the above method, the droplet's diameter, collision angle, and impact velocity can be accurately measured. These high-precision measurements provide reliable input parameters for the subsequent development of the sticking efficiency model.

### 3 Experimental setup

As shown in Fig. 1, a laboratory system is constructed to study the impact of micron-scale droplets on a conductor. The system is divided into two main parts: the first part is a coaxial digital holography measurement system consisting of a laser, a high-speed camera, and lenses. In the experimental optical measurement setup, a pulsed laser beam is first expanded by lens L1 and subsequently collimated into a parallel beam by lens L2, thereby illuminating the region containing simulated raindrops. The diffracted light produced by the particles interferes with the unblocked reference light, forming a coaxial digital hologram of the spray particle field. After propagating a certain distance, the hologram is imaged by a telecentric lens, recorded by the high-speed camera, and then stored on a computer. As shown in Fig. 2, after numerical reconstruction processing, the morphology and three-dimensional positions of the particles in the hologram can be recovered. The second part of the system is a simulated rainfall experimental setup, encompassing a droplet generator, a driving mechanism, and a support structure. Ultrapure water is pre-cooled to a supercooled state and placed in a pressurized chamber. A solenoid injection valve controls the pressure of a nitrogen tank, forcing supercooled water out of a nozzle to produce droplets with a certain velocity (1-8 m/s). By using nozzles of different diameters, supercooled droplets with diameters within the range 500-3000  $\mu\text{m}$  can be generated. The spray generator did not produce perfectly monodisperse droplets. Instead, different nozzles were used to target specific droplet-size ranges, whereas the actual diameter of each impacting droplet was determined through holographic reconstruction and subsequently grouped for analysis. The laboratory temperature-control system maintained the ambient temperature between  $-20\text{ }^\circ\text{C}$  and  $0\text{ }^\circ\text{C}$  (with  $\pm 1\text{ }^\circ\text{C}$  accuracy). In the experiments, droplet diameter, impact velocity, collision angle, supercooling degree, and crosswind speed were treated as control variables. Each nominal condition was repeated at least 5 times to ensure data reliability. Repeated runs were used to confirm the reproducibility of the observed trends, whereas representative valid data were selected only for concise visualization.

[9]: Addresses Reviewer #1 Minor Comments 7 : removes the ambiguous 'three experiments' wording.

[10]: Addresses Reviewer #1 Minor Comments 8 and Reviewer #2 Specific Comment 6: clarifies that droplet size is an experimental variable rather than monodisperse, and explains repeat runs/representative cases.


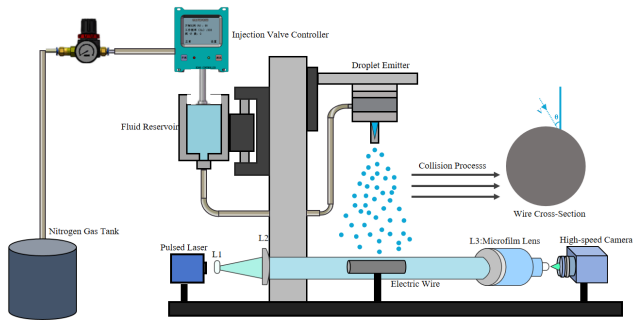


Figure 1: Experimental setup for droplet impact on a power transmission line.

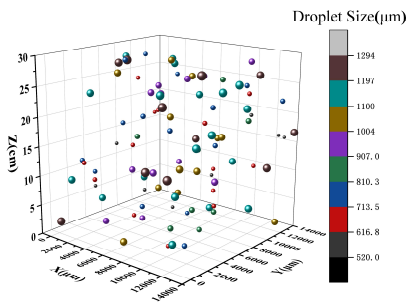

155 Figure 2: Reconstructed three-dimensional spatial distribution of droplets.

The processing workflow for digital holograms and velocity extraction is shown in Fig. 3, including hologram numerical reconstruction, depth-of-field extension, image fusion, particle identification, particle labeling, and velocity calculation steps. Using the above techniques, the splashing process of a group of micron-scale droplets impacting the conductor was measured and reconstructed, as illustrated in Fig. 4. Image recognition determines that the droplet diameter in this case reaches approximately 1100  $\mu\text{m}$ . The analysis of the reconstructed trajectory has yielded a collision angle of about  $70^\circ$ , with an impact velocity of 2.5 m/s.


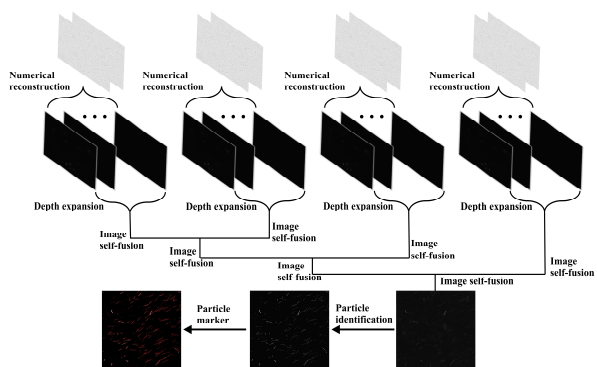


Figure 3: Digital hologram processing workflow for retrieving droplet position and velocity.

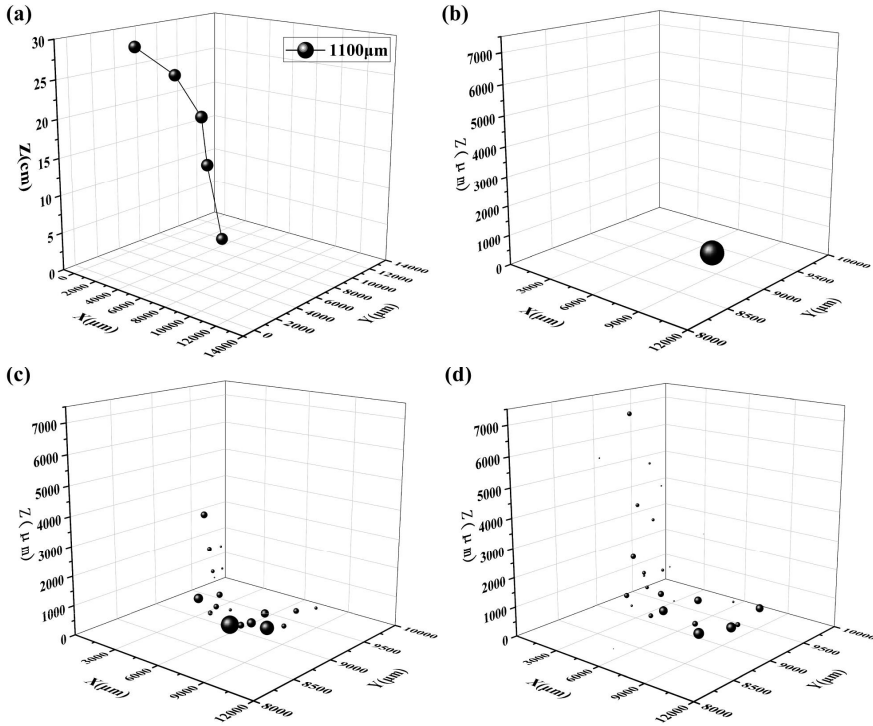

165

Figure 4: Droplet trajectory and splashing process upon impacting the transmission line. (a) Droplet falling trajectory (b) Time-sequential diagram of particle breakage process:  $t=0$ . (c) Time-sequential diagram of particle breakage process:  $t=0.5\text{ms}$  (d) Time-sequential diagram of particle breakage process:  $t=1\text{ms}$ .

4 Development and validation of the sticking efficiency model

170 4.1 Model development

4.1.1 Dynamic phase

For cases with an incoming wind, droplets strike the conductor at some relative collision angle  $\theta$  instead of a perpendicular approach. When a droplet impacts the surface of a cylindrical conductor at a velocity  $v_d$  and collision angle  $\theta$ , the tangential

component of its velocity will induce the droplet to slide and be stripped along the conductor surface, whereas the normal component of velocity is the key driving force targeting the deformation and breakup of droplets. Therefore, during the development progress of the dynamic model, the influence of the normal velocity component on the droplet's attachment behavior should be focused on. The normal impact velocity is defined as:

$$v_n = v_d \cdot \sin\theta, \quad (6)$$

The traditional Weber number formulation is applicable only to the perpendicular impact of droplets and therefore cannot adequately quantify the shear effect during the oblique impact of supercooled droplets under high wind speeds. Experimental results show that when the collision angle  $\theta$  decreases from  $90^\circ$  to  $60^\circ$ , as illustrated in Fig. 5, the observed droplet splashing probability increases by about 10-25%.

The splashing probability is defined as  $P_{sp} = \frac{m_{sp}}{m_0}$ , where  $m_{sp}$  is the liquid mass lost due to splashing after impact and  $m_0$  is the total droplet mass before impact. This trend indicates that smaller collision angles enhance tangential shear, promote asymmetric spreading and liquid removal, and consequently increase the tendency of droplets to splash rather than adhere.

[11]: Addresses Reviewer #1 Minor Comment 9 and Reviewer #2 Major Comment 1: defines splashing probability and links the observed trend to tangential shear.

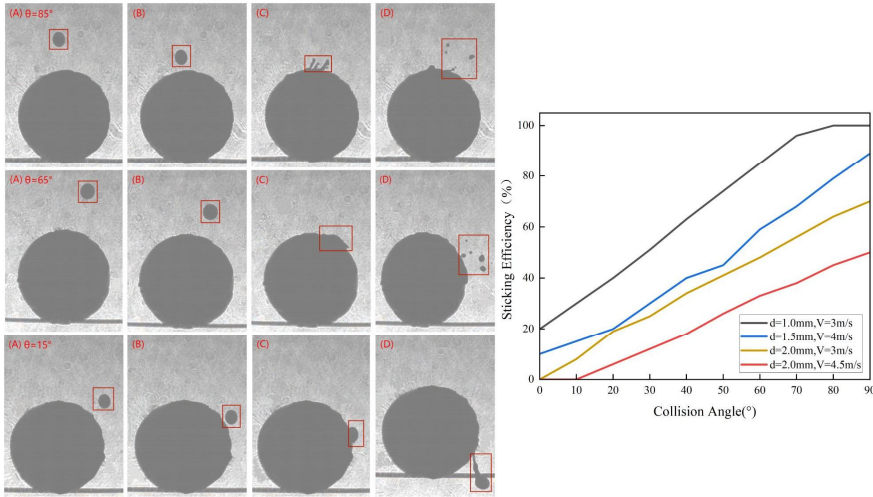


Figure 5: Variation in experimentally measured sticking efficiency under different collision angles.

To quantitatively describe the effect of collision angle on the droplet's dynamic behavior, an effective Weber number  $We_{eff}$  is

introduced to modify the original Weber number. The shear-enhanced effective Weber number model is proposed as follows:

$$We_{eff} = \frac{\rho_d v_n^2 d}{\sigma} \left[ 1 + \lambda \left( \frac{90^\circ - \theta}{90^\circ} \right)^2 \right], \quad (7)$$

where  $\rho$  is the droplet density,  $v_n$  is the normal impact velocity,  $d$  is the droplet diameter, and  $\sigma$  is the surface tension of water. The coefficient  $\lambda$  is an empirical oblique-impact correction term introduced to account for the additional shear effect under non-normal impact conditions. In the present dataset,  $\lambda \approx 0.1$  was obtained by fitting the experimentally

observed shift in the transition between retention and splashing under oblique impact relative to the near-normal case.

As shown in Fig. 6 and Fig. 7, the analysis of high-speed camera data reveals that higher impact velocities will produce a stronger kinetic impulse, promoting droplet splashing; Under the same wind speed and collision angle conditions, smaller droplets will embrace a noticeably higher adhesion rate than larger droplets. These experimental trends indicate that the critical Weber number  $We_{cr}$  is influenced by the nonlinear coupling of collision angle  $\theta$ , droplet diameter  $d$ , and droplet impact velocity  $v_d$ .

[12]: Addresses Reviewer #1 Minor Comment 11 and Reviewer #2 Major Comment 2: explains the derivation and dataset-specific meaning.


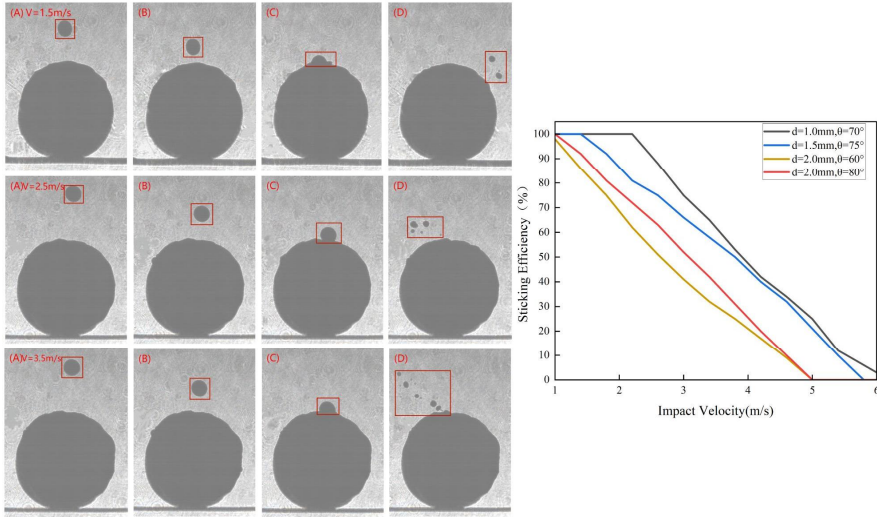


Figure 6: Variation in experimentally measured sticking efficiency with impact velocity.

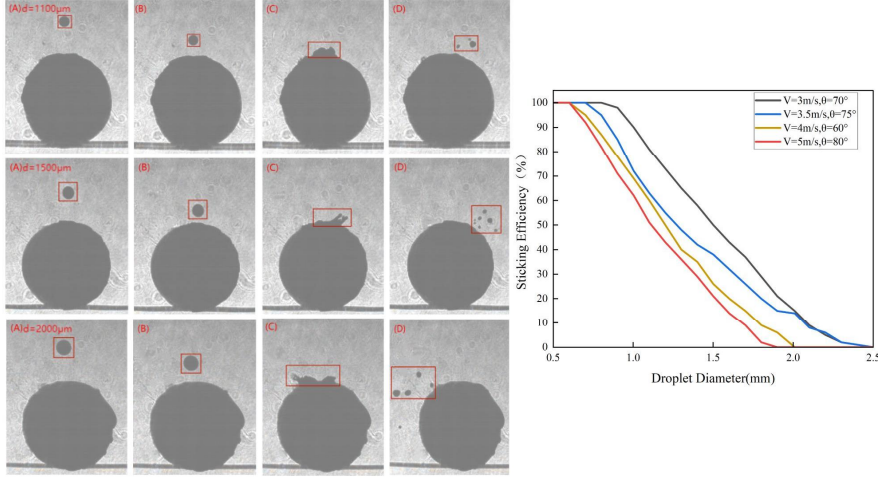

205 **Figure 7: Variation in experimentally measured sticking efficiency with droplet diameter.**

Accordingly, by performing a ternary nonlinear fitting on the experimental data, the modified critical Weber number model is introduced as follows:

$$We_{cr} = C(1 - Ad)(1 - Bv_n^\delta)(1 - \cos\theta), \quad (8)$$

210 where  $C$  is the baseline scale of the critical Weber-number threshold,  $A$  and  $B$  are empirical scaling coefficients, and  $\delta$  is the velocity influence exponent. Experimental calibration for the present dataset yielded  $C = 745$ ,  $A = 0.02$ ,  $B = 0.012$ , and  $\delta = 1.8$ .

Based on the criterion of inertia vs. surface tension competition, the ratio of the effective Weber number to the critical Weber number determines the outcome of droplet attachment. The dynamic attachment probability  $P_s$  is defined as a piecewise function

215 of this ratio:

$$P_s(\theta, d, v) = \begin{cases} 1, & We_{eff} < 0.3We_{cr} \\ \frac{We_{cr} - We_{eff}}{0.7We_{cr}}, & 0.3We_{cr} \leq We_{eff} \leq We_{cr} \\ 0, & We_{eff} > We_{cr} \end{cases} \quad (9)$$

[13]: Addresses Reviewer #1 Minor Comment 12 and Reviewer #2 Major Comment 2: defines C, A, B, and identifies them as empirical fit coefficients.

#### 4.1.2 Thermal phase

High-speed imaging measurements show that the effective contact time  $t_c$  increases with the increase of droplet diameter, and decreases with the increase of impact velocity. Therefore, the calculation of the effective contact time can be simplified as approximately:

$$t_c = \frac{d_d}{v_n}, \quad (10)$$

Traditional models of liquid-solid phase change time typically assume ideal heat conduction, considering only the supercooling  $\Delta T$  as a variable. In reality, however, there is a micrometer-scale oxide layer and an air boundary layer on the conductor surface, significantly inhibiting heat flow. In this study, the kinetic energy of the impacting droplet can disrupt the air film on the conductor surface and increase the actual contact area between the droplet and the conductor; Such effect grows quadratically with  $v_n$ . Therefore, the expression for the liquid-to-solid phase change time is reconstructed to account for kinetic-energy-enhanced heat transfer:

$$t_f = \frac{\rho L d^2}{h_i \Delta T A_c (1 + \beta v_n^2)}, \quad (11)$$

where  $\rho$  is the liquid density,  $L$  is the latent heat of fusion per unit mass of the liquid, and  $h_i$  is the average convective heat-transfer coefficient between the droplet and the conductor, reflecting the heat-transfer capability at the solid-liquid interface. The term  $A_c = 1 + 0.8 \sin \theta$  is an empirical contact-area correction factor introduced to approximate the increase in effective spreading/contact area with collision angle; the coefficient 0.8 was obtained by fitting the angle-dependent spreading behavior observed in the impact images. The parameter  $\beta$  is an empirical enhancement factor introduced to represent the increase in effective interfacial heat transfer caused by impact-induced thinning of the air layer and enhanced liquid-solid contact. For the present dataset,  $\beta \approx 0.05 \text{ s}^2 / \text{m}^2$  was obtained by fitting the freezing-time correction term.

Based on the relationship between  $t_c$  and  $t_f$ , the freezing probability  $P_f$  can be expressed as follows:

If  $t_c \geq t_f$ , sufficient time is available for heat transfer, and the supercooled droplet freezes completely ( $P_f = 1$ ).

If  $t_c < t_f$ , the unfrozen portion of the droplet is removed by the airflow. In this case, the freezing probability is expressed in exponential form as:

$$P_f = \exp\left(-\frac{t_f}{t_c}\right), \quad (12)$$

[14]: Addresses Reviewer #1 Minor Comment 14 and Reviewer #2 Major Comment 2: explains  $A_c$ , the coefficient 0.8, beta, and their calibration meanings.

[15]: Addresses Reviewer #1 Minor Comment 16: explains why a bounded monotonic exponential closure is used when  $t_c < t_f$ .

### 4.1.3 Overall sticking efficiency calculation

The overall sticking efficiency  $\eta$  is essentially the coupled probability of the dynamic collision stage and the thermal freezing stage occurring sequentially. Equation (13) is employed here as a first-order conditional-product approximation rather than as an assumption of strict physical independence. The dynamic stage determines whether sufficient liquid remains on the surface after impact, whereas the thermal stage evaluates whether the retained liquid can freeze within the effective contact time. Part of this coupling is already reflected in the thermodynamic stage through the kinematically dependent contact time  $t_c$  in Eq. (10), as well as through the angle- and impact-dependent correction terms  $A_c$  and  $\beta v_n^2$  in Eq. (11). Thus, the total sticking efficiency can be expressed as the product of the probabilities of the two stages:

$$\eta = P_s \cdot P_f, \quad (13)$$

[16]: Addresses Reviewer #1 General Comment 4 and Reviewer #2 Major Comment 2: clarifies that dynamic and thermal stages are sequentially coupled, not assumed to be fully independent.

### 4.2 Model validation

To rigorously evaluate the accuracy and applicability of the proposed model, three representative sticking efficiency models were selected for comparative analysis: the Jones model (Jones, 1996), the Makkonen model (Makkonen, 2000), and the Mundo-Sommerfeld-Tropea splashing model (Mundo et al., 1995). Using both controlled laboratory experiments and inverse analysis of actual transmission line icing accident data, the prediction accuracy of the sticking efficiency model proposed in this work was evaluated. Because the empirical coefficients in Eq. (8) were calibrated using the laboratory impact dataset, the laboratory comparison presented below should be interpreted as a comparison of the datasets against these formulations under identical laboratory conditions. For all four models, the same measured droplet and environmental input conditions were adopted to the extent permitted by each formulation.

[17]: Addresses Reviewer #1 General Comment 3: clarifies calibration versus validation, benchmark fairness, and common input use for the Jones, Makkonen, and Mundo comparisons.

#### 4.2.1 Experimental design

(1) Laboratory parameters: The laboratory experiments were designed with five factors (droplet diameter, impact velocity, collision angle, supercooling, and crosswind speed), each at three levels, as summarized in Table 1. This yields  $3^5 = 243$  unique test conditions; Each condition was repeated 3 times, for a total of 729 experiments.

**Table 1:** Experimental parameters

Variable	Values	Uni
Droplet diameter $d$	800,1200,2000	$\mu\text{m}$
Impact velocity $v$	2,5,8	m/s
Collision angle $\theta$	30,60,85	$^\circ$ (degrees)
Supercooling $\Delta T$	5,10,15	$^\circ\text{C}$
Crosswind speed $v_w$	0,4,8	m/s

(2) Actual transmission-line icing cases: The proposed model was further evaluated using three real-world transmission-line icing events. In each case, the reference sticking efficiency  $\eta_{\text{mic}}$  was not obtained through direct droplet-by-droplet counting. Instead, it was inferred through inverse analysis based on the observed ice-accretion response of the transmission line together with the estimated incident supercooled water flux under the recorded meteorological conditions. Thus,  $\eta_{\text{mic}}$  denotes a field-reference value inferred from icing observations rather than a directly measured microscopic sticking fraction.

Case 1: Parameters: collision angle  $\theta = 55^\circ$ , droplet diameter  $d = 1120 \mu\text{m}$ , droplet velocity  $v = 6.5 \text{ m/s}$ , supercooling  $\Delta T = 7^\circ\text{C}$ , crosswind speed  $v_w = 3 \text{ m/s}$ .

Case 2: Parameters:  $\theta = 38^\circ$ ,  $d = 1850 \mu\text{m}$ ,  $v = 11.2 \text{ m/s}$ ,  $\Delta T = 6.5^\circ\text{C}$ ,  $v_w = 14 \text{ m/s}$ .

Case 3: Parameters:  $\theta = 75^\circ$ ,  $d = 800 \mu\text{m}$ ,  $v = 4 \text{ m/s}$ ,  $\Delta T = 12^\circ\text{C}$ ,  $v_w = 1 \text{ m/s}$ .

#### 4.2.2 Results analysis

Using the above experimental data, the comparison was conducted on the sticking efficiency results calculated by each model (see Fig. 8), and the prediction errors of each model under the actual icing scenarios (see Figs. 9-11). The results show that the sticking efficiency model proposed in this paper outperforms in terms of accuracy, applicability, and stability. The model can make an effective prediction on the icing sticking efficiency under different combinations of temperature, wind speed, droplet size, and collision angle. Even under complex and severe environmental conditions, such as heavy precipitation accompanied by strong winds and low temperatures, the proposed model maintained prediction errors below 3.5% for the validation cases considered in this study, demonstrating superior predictive performance compared with existing classical models.

[18]: Addresses Reviewer #1 General Comment 3 and Reviewer #1 Minor Comment 15: defines field  $\eta_{\text{true}}$  operationally through inverse analysis of ice-accretion observations and incident supercooled-water flux.

[19]: Addresses Reviewer #1 General Comment 3, Reviewer #1 Minor Comment 4, and Reviewer #2 Major Comment 3: states the error type/reference values and limits the <3.5% claim to the studied validation cases.

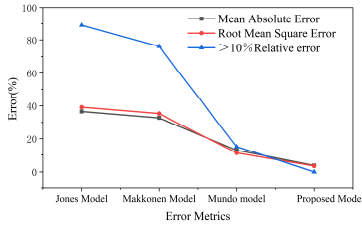


Figure 8: Sticking efficiency results calculated by various models using the laboratory data.

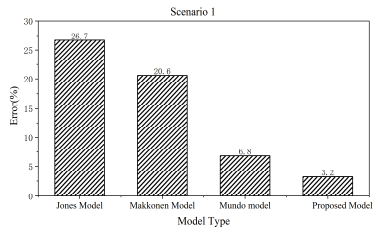


Figure 9: Comparison of sticking efficiency prediction errors for actual case 1.

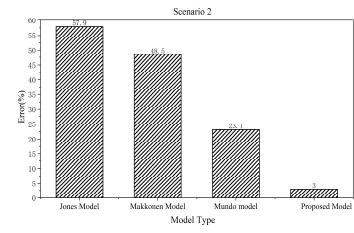


Figure 10: Comparison of sticking efficiency prediction errors for actual case 2.

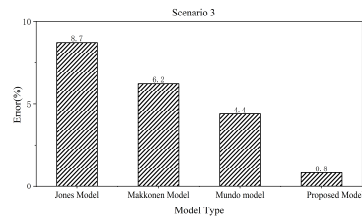


Figure 11: Comparison of sticking efficiency prediction errors for actual case 3.

#### 4.2.3 Sensitivity analysis

The sensitivity analysis was conducted to identify which measured dynamic input most strongly influences the dynamic-stage attachment probability  $P_d$ . The analysis was limited to droplet diameter  $d$ , impact velocity  $v_d$ , and collision angle  $\theta$ , because these three quantities enter the dynamic formulation through the effective Weber number and the retention-splash criterion.

A partial rank correlation coefficient (PRCC) method was used. PRCC is suitable in this context because it is simple, dimensionless, and capable of quantifying the independent influence of each input after removing the effects of the other two variables. In addition, the rank transformation makes the analysis robust for the monotonic but nonlinear response of  $P_s$  near the retention-splash transition.

For each case  $j$  in the validation matrix, the dynamic-stage attachment probability was first calculated from Eqs. (7)–(9):

$$P_{(s,j)} = f(d_j, v_{(d,j)}, \theta_j), j = 1, 2, \dots, N \quad (14)$$

where  $P_{(s,j)}$  is the model-calculated dynamic attachment probability for the  $j$ -th case,  $d_j$  is the measured droplet diameter,  $v_{(d,j)}$  is the measured impact velocity,  $\theta_j$  is the measured collision angle,  $f(\cdot)$  denotes the dynamic model defined by Eqs. (7)–(9), and  $N$  is the total number of cases used in the sensitivity analysis. In practice,  $d_j$ ,  $v_{(d,j)}$ , and  $\theta_j$  were substituted into the dynamic model to obtain  $P_{(s,j)}$  for each row of the validation matrix.

The PRCC for each input variable was then calculated as:

$$p_i = \text{corr}[\text{res}(R(P_s)|R(x_{-i})), \text{res}R(x_i)|R(x_{-i})] \quad (15)$$

where  $p_i$  is the PRCC of the  $i$ -th input variable,  $x_i$  denotes the tested input variable, and  $x_{-i}$  represents the remaining two input variables used as control variables. Here,  $R(\cdot)$  denotes the rank transformation of a variable, with tied values assigned average ranks;  $\text{res}[y|z]$  denotes the residual obtained by linearly regressing  $y$  against  $Z$ , and  $\text{corr}(\cdot, \cdot)$  denotes the Pearson correlation coefficient between the two residual vectors.

The calculation procedure is summarized as follows. First,  $P_s$ ,  $d$ ,  $v_d$ , and  $\theta$  are converted into ranks. Second, when evaluating a given variable such as  $v_d$ , both  $R(P_s)$  and  $R(v_d)$  are separately regressed against the ranks of the other two variables,  $R(d)$  and  $R(\theta)$ . Third, the residuals from these two regressions are correlated to obtain  $p_v$ . The same procedure is repeated for  $d$  and  $\theta$ . Consequently, each PRCC represents the independent monotonic influence of one input on  $P_s$  after the effects of the other two inputs have been removed.

The relative importance of each input variable was calculated from the absolute PRCC value as:

$$I_i = \frac{|p_i|}{(|p_d| + |p_v| + |p_\theta|)} \times 100\% \quad (16)$$

where  $I_i$  is the relative importance of the  $i$ -th input variable,  $|p_i|$  is the absolute PRCC magnitude of that input, and  $|p_d|$ ,  $|p_v|$ , and  $|p_\theta|$  are the absolute PRCC values corresponding to droplet diameter, impact velocity, and collision angle, respectively. The

absolute values are used because the sign of  $p_i$  indicates the direction of influence, whereas its magnitude reflects the strength of influence. The results are summarized in Table 2

**Table 2. PRCC sensitivity analysis of the dynamic-stage attachment probability  $P_s$ .**

Variable	Input levels	PRCC $p_i$	Importance $I_i$	Physical interpretation
Droplet diameter	0.8, 1.2, 2.0 mm	-0.708	34.5%	Higher $d$ increases impact inertia and reduces $P_s$ .
Impact velocity	2, 5, 8 m s <sup>-1</sup>	-0.921	44.8%	Higher $v_d$ strongly promotes deformation, film thinning, and splash.
Collision angle	30, 60, 85°	0.425	20.7%	Higher $\theta$ approaches normal impact and reduces tangential stripping.

325 The results show that the sensitivity ranking is  $v_d > d > \theta$ . Impact velocity exhibits the largest absolute PRCC and contributes 44.8% of the total ranked sensitivity, indicating that the dynamic attachment probability is primarily governed by impact inertia. Droplet diameter is the second most influential variable, because larger droplets possess greater inertia and are therefore more likely to spread, thin, and splash. The collision angle has a smaller but still positive effect; increasing  $\theta$  toward normal impact reduces tangential stripping along the conductor and consequently increases  $P_s$ .

[20]: Reviewer #1 General Comment 2: The sensitivity results are visualized and show why synchronous measurement of  $d$ ,  $v_d$ , and  $\theta$  is necessary.

### 330 5 Conclusions

In this study, a coaxial digital holographic three-dimensional measurement system was employed to achieve synchronized and high-precision measurements of supercooled droplet size distributions, spatial motion trajectories, and impact angles. Such measurement has lifted the limitations of traditional two dimensional projection measurements, addressed the problems of missing motion vector information and missing detections of tiny droplets, and provided accurate physical parameter inputs for the sticking efficiency model. On this basis, a droplet icing sticking efficiency prediction model was developed, which couples the dynamic collision process and the thermal freezing process in multiple stages. Through the comprehensive consideration on factors including wind speed, temperature, droplet size, and collision angle, the model was capable of eliminating the limitation of only handling a single scenario in traditional models. For the laboratory and field-validation cases considered in this study, the proposed model achieved prediction errors below 3.5%, demonstrating superior predictive accuracy compared with existing models. Laboratory simulation tests and validations against typical icing accident cases demonstrate that even under extreme conditions (e.g. mixed wind and rain, high turbulence), the model maintains excellent predictive accuracy and stability. This study lays a theoretical and technical foundation for online monitoring and early warning of transmission line icing, which is of great significance for ensuring the safe operation of the power grid.

**Code availability**

345 Not applicable.

**Data availability**

The data that support the findings of this study are available from the corresponding author upon reasonable request.

**Team list**

Not applicable.

**350 Author contributions**

PZh and DH designed the experiments, and JC carried them out. PZ and JW developed the model code and performed the simulations. JL and XX calibrated and preprocessed the raw data. YM performed data curation. Pu Zhang prepared the manuscript with contributions from all co-authors.

**Competing interests**

355 The authors declare that they have no conflict of interest.

**Disclaimer**

360 Copernicus Publications remains neutral with regard to jurisdictional claims made in the text, published maps, institutional affiliations, or any other geographical representation in this paper. While Copernicus Publications makes every effort to include appropriate place names, the final responsibility lies with the authors. Views expressed in the text are those of the authors and do not necessarily reflect the views of the publisher.

**Acknowledgements**

The authors would like to thank Xi'an University of Technology for the support and assistance provided during the research. The research infrastructure relied on in this study is the Beijing Comprehensive Test Base Laboratory of Weather Modification, and the authors express their gratitude for the platform and technical support offered by the laboratory.

**365 Financial support**

This work was supported by the National Natural Science Foundation of China (Nos. 42375126 and 42375137).

## References

- Blinder, D., Birnbaum, T., Ito, T., and Shimobaba, T.: The state-of-the-art in computer generated holography for 3D display, *Light Adv. Manuf.*, 3, 35, <https://doi.org/10.37188/lam.2022.035>, 2022.
- 370 Chambers, T. E., Reid, I. M., and Hamilton, M.: A lightweight holographic imager for cloud microphysical studies from an untethered balloon, *Atmos. Meas. Tech.*, 17, 3237-3253, <https://doi.org/10.5194/amt-17-3237-2024>, 2024.
- Chen, N., Wang, C., and Heidrich, W.: Snapshot space-time holographic 3D particle tracking velocimetry, *Laser Photonics Rev.*, 15, 2100008, <https://doi.org/10.1002/lpor.202100008>, 2021.
- Fuchs, C., Ramelli, F., Schweizer, D., Lohmann, U., and Henneberger, J.: Putting the spotlight on small cloud droplets with  
375 SmHOLIMO -a new holographic imager for in situ measurements of clouds, *Atmos. Meas. Tech.*, 18, 2969-2986, <https://doi.org/10.5194/amt-18-2969-2025>, 2025.
- Fu, P., Farzaneh, M., and Bouchard, G.: Two-dimensional modelling of the ice accretion process on transmission line wires and conductors, *Cold Reg. Sci. Technol.*, 46, 132-146, <https://doi.org/10.1016/j.coldregions.2006.06.004>, 2006.
- Gao, P.: Observation method of three-dimensional particle velocity based on digital holography, MD thesis, Xi'an University of  
380 Technology, Xi'an, China, 2024.
- Gao, P., Wang, J., Zhao, C. C., Tang, J. B., Liu, J. J., Yan, Q., and Hua, D. X.: Simultaneous measurement method of cloud microphysical parameters based on digital holographic interferometry, *Acta Phys. Sin.*, 70, 099201, <https://doi.org/10.7498/aps.70.20201779>, 2021.
- Gao, W., Sato, Y., and Zhou, K.: CFD-DEM modeling of bidirectional coupling between micron droplets and conductor vibration,  
385 *Powder Technol.*, 425, 118572, <https://doi.org/10.1016/j.powtec.2023.118572>, 2024.
- Goodman, J. W.: *Introduction to Fourier optics*, McGraw-Hill, New York, USA, 1968.
- Hou, H., Wang, Y., Bai, X., Lv, J., Cui, R., Zhang, L., and Li, S.: Modelling icing growth on overhead transmission lines: Current advances and future directions, *Energy Convers. Econ.*, 5, 062001, <https://doi.org/10.1049/enc2.12131>, 2024.
- Huang, Z. and Cao, L.: Quantitative phase imaging based on holography: trends and new perspectives, *Light Sci. Appl.*, 13, 145,  
390 <https://doi.org/10.1038/s41377-024-01453-x>, 2024.
- Snaiki, R., Jamali, A., Rahem, A., Shabani, M., and Barjenbruch, B. L.: A metaheuristic-optimization-based neural network for icing prediction on transmission lines, *Cold Reg. Sci. Technol.*, 224, 104249, <https://doi.org/10.1016/j.coldregions.2024.104249>, 2024.
- Javidi, B., Carnicer, A., Anand, A., Barbastathis, G., Chen, W., Ferraro, P., Goodman, J., Horisaki, R., Khare, K., Kujawinska, M.,  
395 and Leitgeb, R. A.: Roadmap on digital holography, *Opt. Express*, 29, 35078-35118, <https://doi.org/10.1364/OE.435915>, 2021.
- Jiang, X., Wang, Z., and Liu, Y.: Laser diffraction-based characterization of raindrop size distribution in freezing precipitation, *Atmos. Res.*, 259, 105682, <https://doi.org/10.1016/j.atmosres.2021.105682>, 2021.
- Jones, K. F.: A simple model for freezing rain ice loads, *Atmos. Res.*, 46, 87-97, [https://doi.org/10.1016/S0169-8095\(97\)00053-7](https://doi.org/10.1016/S0169-8095(97)00053-7), 1996.

- 400 Khodadad, D.: Digital holography and its application, *Appl. Sci.*, 14, 11254, <https://doi.org/10.3390/app142311254>, 2024.
- Kringlebotn Nygaard, B. E., Ágústsson, H., and Somfalvi-Tóth, K.: Modeling wet snow accretion on power lines: Improvements to previous methods using 50 years of observations, *J. Appl. Meteorol. Climatol.*, 52, 2189-2203, <https://doi.org/10.1175/JAMC-D-12-0332.1>, 2013.
- Kumar, M. S. and Hong, J.: A review of 3D particle tracking and flow diagnostics using digital holography, *Meas. Sci. Technol.*, 36, 032005, <https://doi.org/10.1088/1361-6501/adabff>, 2025.
- 405 Liu, F., Chen, T., and Wu, J.: Physics-informed neural networks for predicting ice accretion on power lines, *Appl. Energy*, 350, 121890, <https://doi.org/10.1016/j.apenergy.2023.121890>, 2024.
- Liu, Z., Takahashi, T., Lindsay, D., Thevar, T., Sangekar, M., Watanabe, H. K., Burns, N., Watson, J., and Thornton, B.: Digital in-line holography for large-volume analysis of vertical motion of microscale marine plankton and other particles, *IEEE J. Oceanic Eng.*, 47, 789-801, <https://doi.org/10.1109/JOE.2021.3066788>, 2021.
- 410 Makkonen, L.: A model for the growth of rime, glaze and wet snow on structures, *Phil. Trans. R. Soc. A*, 358, 2913-2939, <https://doi.org/10.1098/rsta.2000.0690>, 2000.
- Makkonen, L. and Stallabrass, J. R.: Two-dimensional high-speed imaging of droplet impact dynamics, *J. Atmos. Oceanic Technol.*, 36, 1523-1534, <https://doi.org/10.1175/JTECH-D-18-0184.1>, 2019.
- 415 Mihaylova, E. M.: Imaging of live cells by digital holographic microscopy, *Photonics*, 11, 980, <https://doi.org/10.3390/photonics11100980>, 2024.
- Mundo, C., Sommerfeld, M., and Tropea, C.: Droplet-wall collisions: experimental studies of the deformation and breakup processes, *Int. J. Multiphase Flow*, 21, 151-173, [https://doi.org/10.1016/0301-9322\(94\)00069-V](https://doi.org/10.1016/0301-9322(94)00069-V), 1995.
- Osten, W. and Pedrini, G.: 55 Years of holographic non-destructive testing and experimental stress analysis: Is there still progress to be expected?, *Light Adv. Manuf.*, 3, 121-136, <https://doi.org/10.37188/lam.2022.008>, 2022.
- 420 Wang, G., Shen, J., Jin, M., Huang, S., Li, Z., and Guo, X.: Prediction model for transmission line icing based on data assimilation and model integration, *Front. Environ. Sci.*, 12, 1403426, <https://doi.org/10.3389/fenvs.2024.1403426>, 2024.
- Yang, C. Y., Wang, J., Zhang, C., Zhou, H., Yang, J. S., Yue, Z. G., Liang, G., Liu, J. J., and Hua, D. X.: Observation method of cloud ice crystal microphysical parameters based on digital holography, *Acta Optica Sin.*, 44, 0601017, <https://doi.org/10.3788/AOS231067>, 2024.
- 425 Zhang, X., Liu, X., Wu, X., and Min, J.: Impacting-freezing dynamics of a supercooled water droplet on a cold surface: Rebound and adhesion, *Int. J. Heat Mass Transfer*, 158, 119997, <https://doi.org/10.1016/j.ijheatmasstransfer.2020.119997>, 2020.
- Zhou, H.: Hail recognition method and experimental research based on digital holography, MD thesis, Xi'an University of Technology, Xi'an, China, 2024.

430